



Boundary traps

This technical note provides advice to the plumbing industry on the installation requirements and configuration of boundary traps. Boundary traps perform a vital role in sewerage networks, protecting the main drains of private properties and the community from harmful sewer gases. Redevelopment of properties in older suburbs has heightened these risks and this technical note may assist licensed plumbing contractors to establish when boundary traps are required in both new subdivisions and redevelopment work areas.

Connection

It is the licensed plumbing contractor's responsibility to determine a "boundary trap area" which is an area where boundary traps are required by the water services provider. As the major water services provider in WA, the Water Corporation may install boundary traps as part of the sewerage infrastructure in a new subdivision.

Before connecting new buildings to the main sewer in both new and established suburbs, the licensed plumbing contractor needs to check the size of the sewer and the other situations where boundary traps are required.

Water Corporation boundary trap areas are where junctions are located on:

- ▶ sewers that are 300 mm or larger in diameter;
- ▶ IO or IS sewers where the downstream sewer is 300 mm or larger in diameter; and
- ▶ sewers, regardless of their diameter, that convey a major pumped discharge.

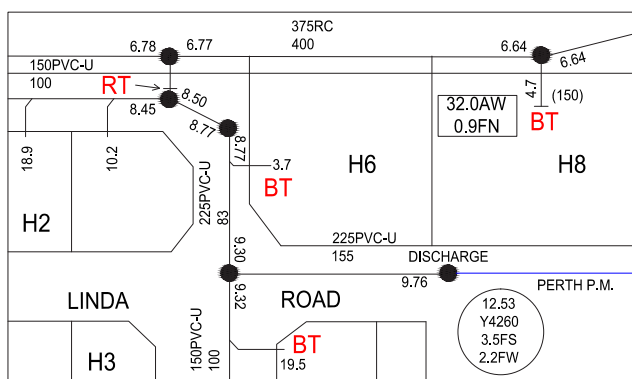


Diagram 1: Water Corporation 'E' plan example

The Water Corporation drainage mapping system can be accessed through the Esinet program on their website:

Esinet-mw.watercorporation.com.au

Configuration and construction

A boundary trap may be installed when the connection point is installed as part of the main sewerage infrastructure or at the time a property is connected to the sewer. The type of trap needed will be determined by the depth of the main drain and main sewer.

They can be either:

- (a) A 'P' type for inspection shaft rising shafts; or
- (b) A running type on grade for inspection shaft square on back configurations.

DN 100 'P' type boundary traps

The photo below shows a specialised DN 100 trap which can be purchased and must be used as a boundary trap. They have a swept outlet in accordance with Water Corporation requirements that allows smoother flow of wastewater.



Photo 1: Specialised DN 100 'P' type boundary trap

DN 150 'P' type boundary traps

Diagram 2 below shows a 'P' type boundary trap of DN 150, constructed using a configuration of approved WaterMarked fittings. This trap shall be fabricated to provide a water seal of 150 mm ± 5 mm and used at the base of an inspection shaft rising shaft.

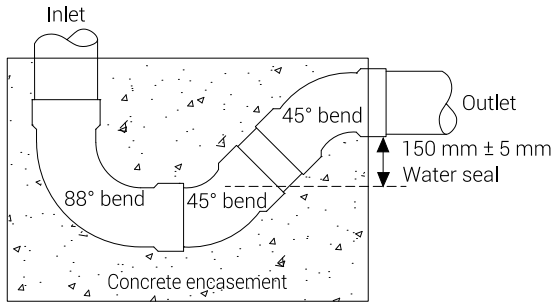


Diagram 2: DN 150 'P' type boundary trap

Running type boundary traps

Boundary traps on grade (running type) in DN 100 and DN 150 can also be constructed using approved WaterMarked fittings as in diagrams 3 and 4.

Diagram 3 below shows a DN 100 running type boundary trap derived from the Water Corporation's Design Standard DS50. The trap shall be fabricated to provide a water seal of 75 mm ± 5 mm and used only for property connections made on grade.

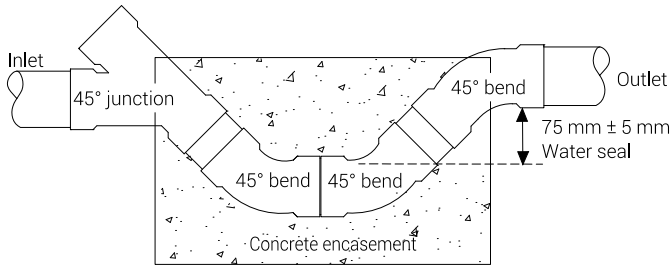


Diagram 3: DN 100 running type boundary trap

Diagram 4 below shows a DN 150 running type boundary trap that is constructed incorporating an 88° bend. The trap shall be fabricated to achieve a water seal of 150 mm ± 5 mm and used only for property connections made on grade.

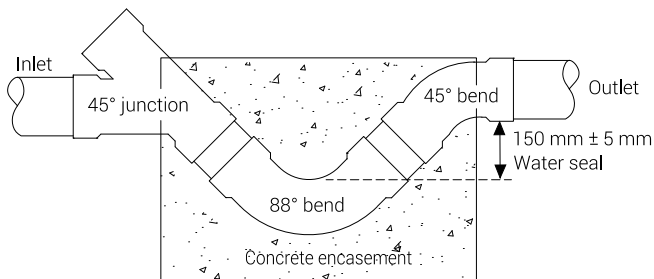


Diagram 4: DN 150 running type boundary trap

Note:

1. Boundary traps larger than DN 150 will require a water seal that is equal to the nominal diameter of pipe. For example, the water seal for a DN 225 trap would be 225 mm ± 5 mm.

Installation, location and venting

Boundary traps within properties shall be installed in the main drain, located at or near the point of connection to the main sewer and installed in accordance with AS/NZS 3500.2:2025, clause 4.4.

The main drain that incorporates a boundary trap must have an upstream and downstream vent in accordance with AS/NZS 3500.2:2025, clause 3.9.1.

Where a downstream boundary trap vent is required by AS/NZS 3500.2:2025, clause 3.9.1(a), it shall be installed as follows –

- (a) the vent may be connected to the rising shaft, the inspection shaft or main drain not more than 10m from the boundary trap riser provided no other fixture is connected between the vent and the boundary trap riser, see diagrams 5 and 6.
- (b) the vent is sized in accordance with clause 3.9.3.1(d) so that the fixture unit loading on the main drain determines the size of the vent with a minimum size not less than DN 50.



Photo 2: Example of low level vent termination

Termination of low level vents

Low level vents serving boundary traps can be constructed using approved WaterMarked fittings and terminate in accordance with AS/NZS 3500.2:2025, clause 3.9.2.3.

The standard is subject to a WA variation in the Plumbing Code of Australia, schedule 11 that restricts the maximum unsupported height to 250 mm, see options 1 or 2 shown in diagram 7.

AS/NZS 3500.2:2025, clause 6.10.1 does not allow air admittance valves to be used as downstream vents serving boundary traps.

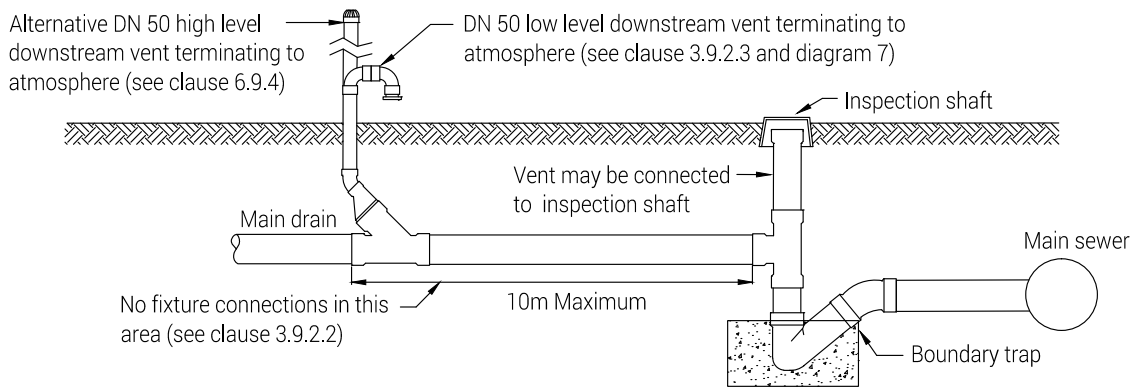


Diagram 5: Boundary trap installation ('P' type)

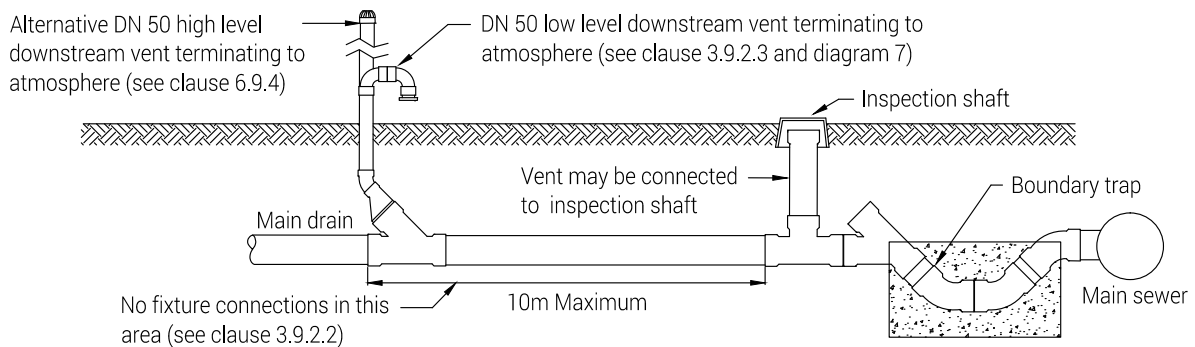


Diagram 6: Boundary trap installation (running type)

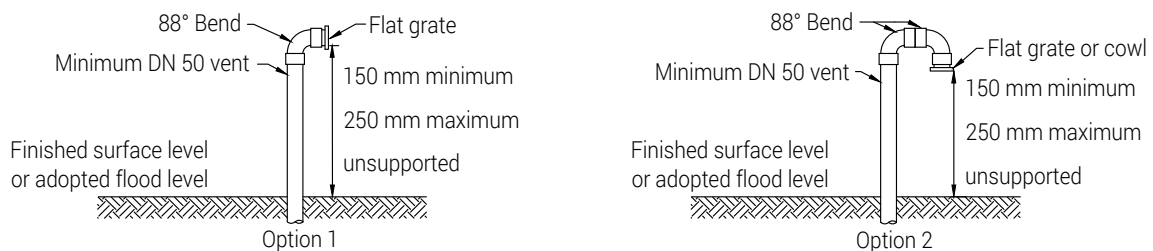


Diagram 7: Options for low level vent termination

Notes

The technical note series is issued by Building and Energy to assist the plumbing industry to comply with the Plumbers Licensing and Plumbing Standards Regulations 2000 (the Regulations) applicable to plumbing work in Western Australia.

Each technical note is to be read in conjunction with Part 6 of the Regulations that currently adopt the Plumbing Code of Australia (PCA) as the standards that apply to the carrying out of plumbing work in WA. The PCA contains specific deemed to satisfy provisions and applies AS/NZS 3500:2025, parts 1, 2 and 4 to plumbing work. PCA, schedule 11 applies variations to certain matters to suit the state's building approach and other local conditions.

Disclaimer

The material published by the Building and Energy is provided voluntarily as a service to the plumbing industry. The information and advice provided is made available in good faith and is derived from sources believed to be reliable and accurate at the time of publication. The information is provided solely on the basis that readers will be responsible for making their own assessment of the matters discussed therein and are advised to verify all relevant representations, statements and information. Changes in circumstances after a document has been published may impact on the accuracy of the information. No assurance is given as to the accuracy of any information or advice contained after publication. This publication may be reproduced or copied without charge for research and educational purposes with due acknowledgement of the source.

© May 2026 Department of Local Government, Industry Regulation and Safety